




**ENERG**  
енергия · ενέργεια

Y IJA  
IE IA

Ochsner

AIR 29





55 °C

35 °C



A<sup>++</sup>

A<sup>++</sup>

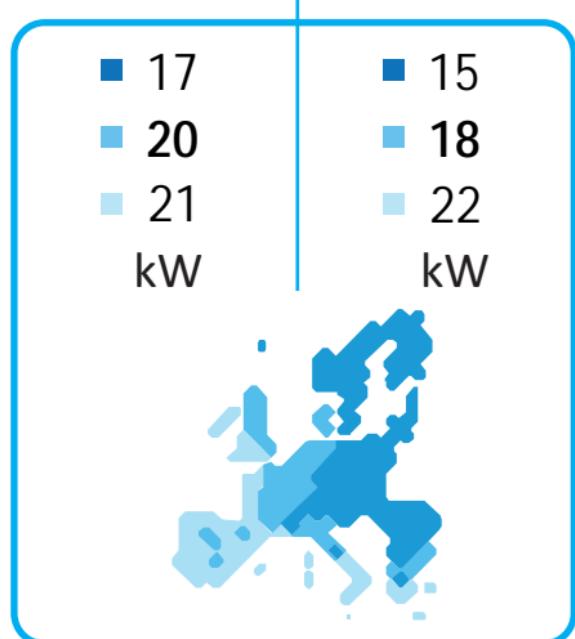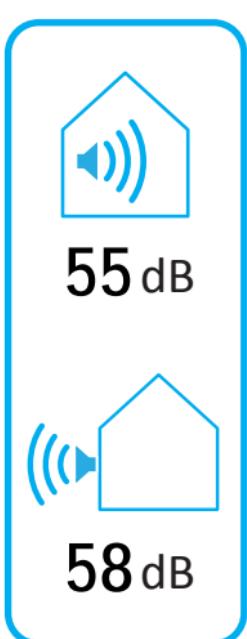

2015

811/2013

**Technische Daten der Wärmepumpe:**

**Heatpump datasheet:**

Hersteller: Manufacturer:	OCHSNER		
Modell: Model:	AIR 29 C12A		

**Angaben zur Energieeffizienzklasse und der Nennleistung:**

**Information concerning energy efficiency class and rated heat output:**

	average / low	average / medium	
Energieeffizienzklasse Raumheizung: Energy efficiency class space heater:	A++	A++	-
Wärmennennleistung: Rated heat output:	18	20	kW
Energieeffizienz Raumheizung: Energy efficiency space heater:	174	138	%
Jährlicher Endenergieverbrauch Raumheizung: Annual final energy consumption space heater:	8617	11613	kWh
Schallleistungspegel in Innenräumen Sound power level indoors	55		dB

**Besondere Vorkehrungen bei Zusammenbau, Installation oder Wartung:**

**Special precautions concerning assembly, installation or maintenance:**

Sowohl die Auslegung als auch der Anschluss, Aufbau und die Befüllung der Anlage wurde nach gültigen Normen, Vorschriften und Verordnungen durch eine dazu ermächtigte Fachfirma oder Fachhandwerk vorgenommen. Besteht die Anlagen aus mehreren Geräteteilen sind diese mit OCHSNER Originalzubehör aus dem Lieferumfang von OCHSNER zu verbinden und zu errichten. Anlagenteile sind auf kürzestem und direktem Wege miteinander zu verbinden und überschreiten den Verbindungsabstand von 5m nicht. Unter Einhaltung der Bedienungs- und Installationsanleitung wird die Anlage im Rahmen seines bestimmungsgemäßen Gebrauch für eine privat genutzte Gebäudeheizung verwendet. Die Inbetriebnahme hat ausschließlich durch den OCHSNER Werkstundendienst stattzufinden. Wartungen und Inspektionen nach Herstellerangaben sind mindestens alle 12 Monate durchzuführen, sofern nicht Gesetze und Verordnungen zu einem häufigeren Intervall auffordern.

The system was sized, connected, laid out and filled in accordance with applicable standards, regulations and ordinances by a qualified contractor. If the system consists of several sections, these must be connected and installed using original OCHSNER accessories as supplied by OCHSNER. System sections must be connected via the shortest route possible and must not exceed a connection distance of 5 m. In accordance with the operating and installation manual, the system is used as intended for a private building heating system. Commissioning must only be carried out by OCHSNER Customer Service. Maintenance and inspection according to the manufacturer's instructions must be carried out at least every 12 months unless legal requirements and ordinances specify a shorter interval.

Zusätzliche Angaben: Additional information:	low	medium	
Wärmennennleistung kälteres Klima Rated heat output colder climate	15	17	kW
Wärmennennleistung wärmeres Klima Rated heat output warmer climate	22	21	kW
Energieeffizienz Raumheizung kälteres Klima Energy efficiency space heater colder climate	160	128	%
Energieeffizienz Raumheizung wärmeres Klima Energy efficiency space heater warmer climate	196	156	%
Jährl. Energieverbrauch Raumheizung kälteres Klima Annual energy consumption space heater colder climate	8791	13133	kWh
Jährl. Energieverbrauch Raumheizung wärmeres Klima Annual energy consumption space heater warmer climate	5851	7073	kWh
Schallleistungspegel im Außenbereich Sound power level outdoors	58		dB

**Technische Daten des Temperaturreglers:**

**Technical data of the temperature controller:**

Hersteller: Manufacturer:	OCHSNER		
Modell: Model:	OTE		

Klasse des Reglers mit Raumfernbedienung Controller class with room remote control	VII	-
Beitrag des Reglers zur Raumheizungs-Energieeffizienz mit Raumfernbedienung Contribution of the controller to the energy efficiency space heater with room remote control	3,5	%
Klasse des Reglers ohne Raumfernbedienung Controller class without room remote control	III	-
Beitrag des Reglers zur Raumheizungs-Energieeffizienz ohne Raumfernbedienung Contribution of the controller to the energy efficiency space heater without room remote control	1,5	%

<b>Manufacturer:</b> Ochsner
<b>Model:</b> AIR 29
<b>Air - to-water heat pump</b>
Low-temperature heat pump: no
Equipped with a supplementary heater: no
Heat pump combination heater: no
Application: low
Climate: average

Item	Symbol	Value	Unit
<b>Rated heat output *</b>	<i>P<sub>rated</sub></i>	18	kW
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature $T_j$			
$T_j = -7 \text{ }^\circ\text{C}$	<i>P<sub>dh</sub></i>	17,5	kW
$T_j = +2 \text{ }^\circ\text{C}$	<i>P<sub>dh</sub></i>	21,9	kW
$T_j = +7 \text{ }^\circ\text{C}$	<i>P<sub>dh</sub></i>	25,9	kW
$T_j = +12 \text{ }^\circ\text{C}$	<i>P<sub>dh</sub></i>	29,7	kW
$T_j$ = bivalent temperature	<i>P<sub>dh</sub></i>	17,0	kW
$T_j$ = operation limit	<i>P<sub>dh</sub></i>	16,1	kW
For air-to-water heat pumps: $T_j = -15 \text{ }^\circ\text{C}$ (if $TOL < -20 \text{ }^\circ\text{C}$ )	<i>P<sub>dh</sub></i>	13,7	kW
Bivalent temperature	<i>T<sub>biv</sub></i>	-8	°C
Power input "compressor off"		0	W
Power consumption in modes other than active mode			
Off mode	<i>P<sub>OFF</sub></i>	20	W
Thermostat-off mode	<i>P<sub>TO</sub></i>	20	W
Standby mode	<i>P<sub>SB</sub></i>	20	W
Crankcase heater mode	<i>P<sub>CK</sub></i>	0	W
Other items			
Capacity control	fixed		
Sound power level, indoors/outdoors	<i>L<sub>WA</sub></i>	55,5	dB
		58	
Annual energy consumption	<i>Q<sub>HE</sub></i>	8617	kWh

Item	Symbol	Value	Unit
<b>Seasonal space heating energy efficiency</b>	$\eta_S$	174	%
Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature $T_j$			
$T_j = -7 \text{ }^\circ\text{C}$	<i>COPd</i>	3,55	
$T_j = +2 \text{ }^\circ\text{C}$	<i>COPd</i>	4,42	
$T_j = +7 \text{ }^\circ\text{C}$	<i>COPd</i>	4,97	
$T_j = +12 \text{ }^\circ\text{C}$	<i>COPd</i>	5,62	
$T_j$ = bivalent temperature	<i>COPd</i>	3,46	
$T_j$ = operation limit	<i>COPd</i>	3,26	
For air-to-water heat pumps: $T_j = -15 \text{ }^\circ\text{C}$ (if $TOL < -20 \text{ }^\circ\text{C}$ )	<i>COPd</i>	2,84	
For air-to-water heat pumps: Operation limit temperature	<i>TOL</i>	-23	°C
Heating water operating limit temperature	<i>WTOL</i>	65	°C
Supplementary heater			
Rated heat output *	<i>P<sub>sup</sub></i>	2,37	kW
Type of energy input			
For air-to-water heat pumps: Rated air flow rate, outdoors			
For water-/brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger	-	8000	m <sup>3</sup> /h
			l/h

Contact details: Ochsner,
* For heat pump space heaters and heat pump combination heaters, the rated heat output <i>P<sub>rated</sub></i> is equal to the design load for heating <i>P<sub>designh</sub></i> , and the rated heat output of a supplementary heater <i>P<sub>sup</sub></i> is equal to the supplementary capacity for heating <i>sup(Tj)</i> .

<b>Manufacturer:</b> Ochsner
<b>Model:</b> AIR 29
<b>Air - to-water heat pump</b>
Low-temperature heat pump: no
Equipped with a supplementary heater: no
Heat pump combination heater: no
Application: medium
Climate: average

Item	Symbol	Value	Unit
<b>Rated heat output *</b>	<i>P<sub>rated</sub></i>	20	kW
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature $T_j$			
$T_j = -7 \text{ } ^\circ\text{C}$	<i>P<sub>dh</sub></i>	17,5	kW
$T_j = +2 \text{ } ^\circ\text{C}$	<i>P<sub>dh</sub></i>	21,4	kW
$T_j = +7 \text{ } ^\circ\text{C}$	<i>P<sub>dh</sub></i>	25,6	kW
$T_j = +12 \text{ } ^\circ\text{C}$	<i>P<sub>dh</sub></i>	29,2	kW
$T_j$ = bivalent temperature	<i>P<sub>dh</sub></i>	17,5	kW
$T_j$ = operation limit	<i>P<sub>dh</sub></i>	16,3	kW
For air-to-water heat pumps: $T_j = -15 \text{ } ^\circ\text{C}$ (if $TOL < -20 \text{ } ^\circ\text{C}$ )	<i>P<sub>dh</sub></i>	14,6	kW
Bivalent temperature	<i>T<sub>biv</sub></i>	-7	°C
Power input "compressor off"		0	W
Power consumption in modes other than active mode			
Off mode	<i>P<sub>OFF</sub></i>	20	W
Thermostat-off mode	<i>P<sub>TO</sub></i>	20	W
Standby mode	<i>P<sub>SB</sub></i>	20	W
Crankcase heater mode	<i>P<sub>CK</sub></i>	0	W
Other items			
Capacity control	fixed		
Sound power level, indoors/outdoors	<i>L<sub>WA</sub></i>	55,5	dB
		58	
Annual energy consumption	<i>Q<sub>HE</sub></i>	11613	kWh

Item	Symbol	Value	Unit
<b>Seasonal space heating energy efficiency</b>	$\eta_S$	138	%
Declared coefficient of performance or primary energy ratio for part load at indoor temperature 20 °C and outdoor temperature $T_j$			
$T_j = -7 \text{ } ^\circ\text{C}$	<i>COPd</i>	2,68	
$T_j = +2 \text{ } ^\circ\text{C}$	<i>COPd</i>	3,48	
$T_j = +7 \text{ } ^\circ\text{C}$	<i>COPd</i>	4,10	
$T_j = +12 \text{ } ^\circ\text{C}$	<i>COPd</i>	4,79	
$T_j$ = bivalent temperature	<i>COPd</i>	2,68	
$T_j$ = operation limit	<i>COPd</i>	2,43	
For air-to-water heat pumps: $T_j = -15 \text{ } ^\circ\text{C}$ (if $TOL < -20 \text{ } ^\circ\text{C}$ )	<i>COPd</i>	2,06	
For air-to-water heat pumps: Operation limit temperature	<i>TOL</i>	-15	°C
Heating water operating limit temperature	<i>WTOL</i>	65	°C
Supplementary heater			
Rated heat output *	<i>P<sub>sup</sub></i>	3,45	kW
electricity			
Type of energy input			
For air-to-water heat pumps: Rated air flow rate, outdoors	-	8000	m <sup>3</sup> /h
For water-/brine-to-water heat pumps: Rated brine or water flow rate, outdoor heat exchanger	-		l/h

Contact details: Ochsner,
* For heat pump space heaters and heat pump combination heaters, the rated heat output <i>P<sub>rated</sub></i> is equal to the design load for heating <i>P<sub>designh</sub></i> , and the rated heat output of a supplementary heater <i>P<sub>sup</sub></i> is equal to the supplementary capacity for heating <i>sup(Tj)</i> .